


Exhibit 2

Figure 2A-3

Typical Installation of the Healy ORVR Phase II Vapor Recovery System

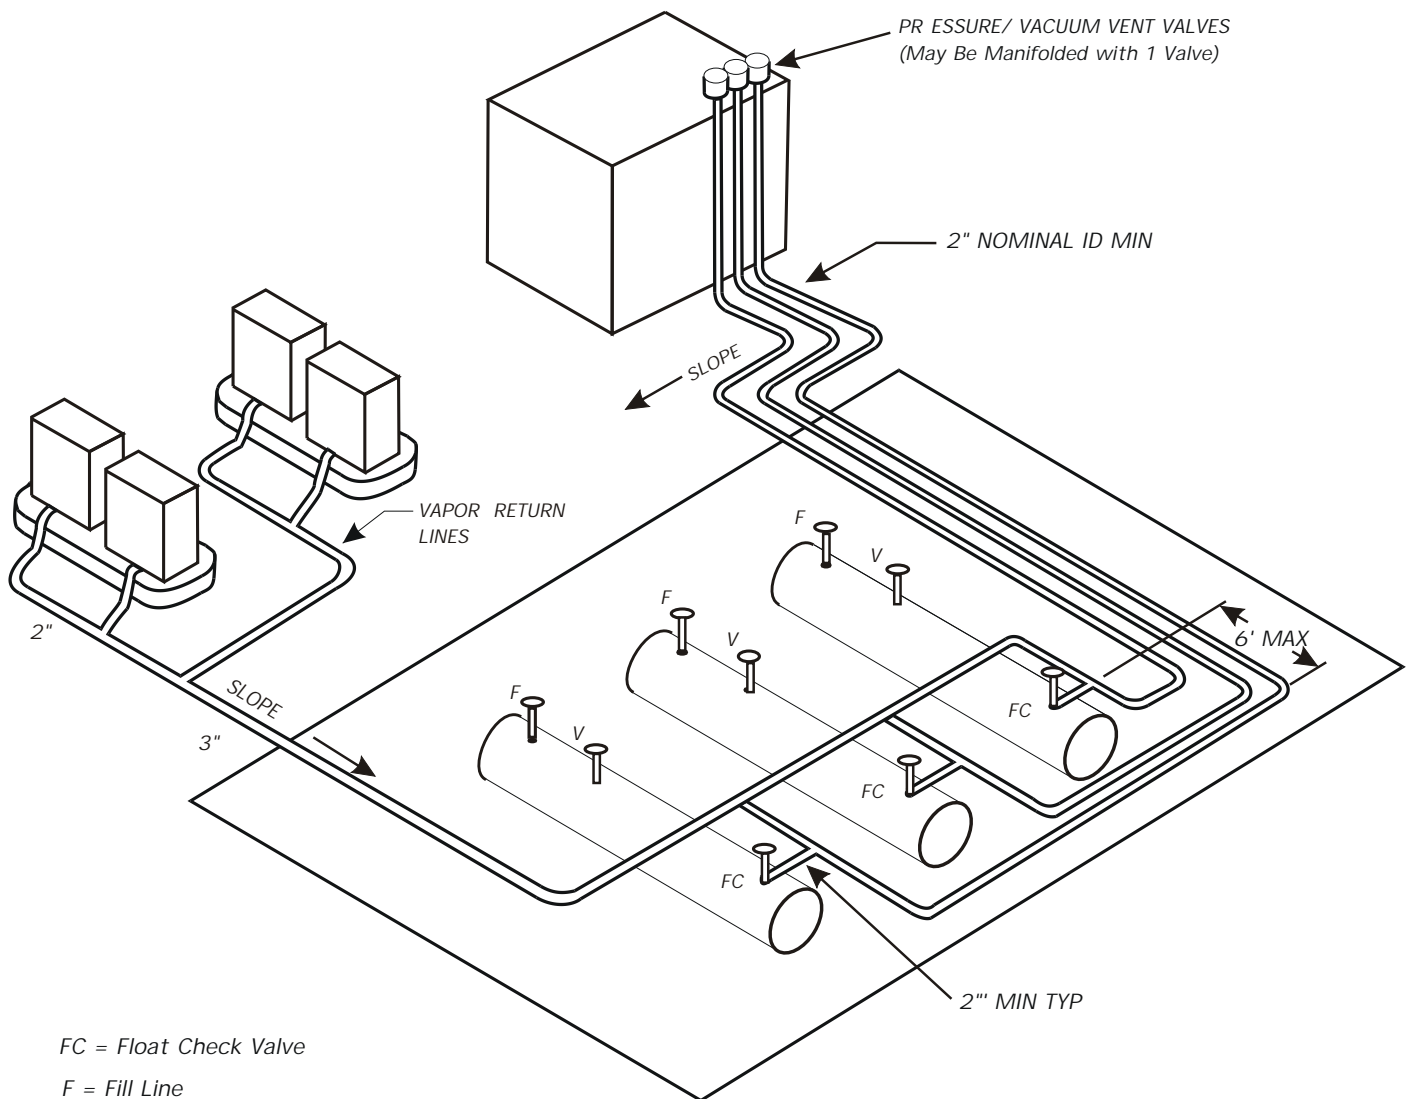

FC = Float Check Valve

F = Fill Line

V = Phase I Vapor Recovery

*Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum
Except as Noted in Exhibit 2 under Vapor Recovery Piping Configurations*

2. Slope: 1/8" per foot Min.
1/4" per Foot Preferred